

March 23rd, 2011

Fukushima Dai-ichi
Monitoring points

- ① North side of main office building (approx. 0.5km from Unit 2 in northwest direction)
 ② Near Gymnasium (East side of MP-5) (approx. 0.9km from Unit 2 in westnorthwest direction)
 ③ Near West Gate (near MP-5) (approx. 1.1km from Unit 2 in west direction)
 ④ Front of near Main Gate (near MP-6) (approx. 1.0km from Unit 2 in westnorthwest direction)

Monitoring points	④																							
monitoring car	0:00	0:10	0:20	0:30	0:40	0:50	1:00	1:10	1:20	1:30	1:40	1:50	2:00	2:10	2:20	2:30	2:40	2:50	3:00	3:10	3:20	3:30	3:40	3:50
Reading (μ Sv/h)	233.4	233.3	232.3	231.6	230.1	229.4	227.5	227.4	227.2	226.8	226.8	226.7	226.7	226.9	227.1	227.1	227.2	227.3	227.6	228.5	228.7	228.8	228.8	229.0
neutron	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	NW	NW	NNW	W	NW	NE	N	NE	NNW	NNW	NNW	N	N	N	NW	N	N	NW	NNW	N	NNW	NNW	N	NW
wind speed (m/s)	1.8	1.8	2.6	4.3	2.5	5.5	2.4	6.5	6.0	4.2	3.4	3.3	3.2	2.8	2.8	2.9	3.0	3.1	2.9	2.2	2.3	2.3	2.6	2.2

Monitoring points	④																							
monitoring car	4:00	4:10	4:20	4:30	4:40	4:50	5:00	5:10	5:20	5:30	5:40	5:50	6:00	6:10	6:20	6:30	6:40	6:50	7:00	7:10	7:20	7:30	7:40	7:50
Reading (μ Sv/h)	229.1	229.1	229.4	229.3	229.5	229.5	229.5	229.3	229.6	229.5	229.5	229.7	229.6	229.6	229.4	229.6	229.5	229.5	229.3	229.5	229.3	229.5	229.0	229.3
neutron	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	N	NW	NNW	NW	NNW	N	N	N	NNW	NW	NNW	NW	NNW	NNW	NW	NNW	NW	NNW	NNW	NNW	NNW	NNW	N	N
wind speed (m/s)	2.1	2.1	2.4	1.7	1.8	2.1	2.1	1.8	2.2	2.1	2.2	2.4	2.5	2.5	2.6	2.7	2.4	2.1	2.7	2.4	2.6	2.8	3.0	2.5

Monitoring points	④																							
monitoring car	8:00	8:10	8:20	8:30	8:40	8:50	9:00	9:10	9:20	9:30	9:40	9:50	10:00	10:10	10:20	10:30	10:40	10:50	11:00	11:10	11:20	11:30	11:40	11:50
Reading (μ Sv/h)	229.4	229.5	229.2	229.4	229.1	229.1	229.1	228.7	227.6	226.9	228.6	227.6	211.4	227.7	227.2	227.3	227.1	227.2	227.0	226.8	226.8	226.3	225.7	226.3
neutron	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	N	N	NNW	NNW	NNW	NNW	N	NNE	N	N	NNE	NNE	N	N	NNE	N	NNW	N	NNW	N	NNE	NNE	N	N
wind speed (m/s)	3.1	3.2	3.5	3.9	4.4	3.1	3.5	3.3	2.9	3.4	2.5	3.1	2.6	2.7	3.1	2.9	2.9	3.1	3.0	2.6	2.5	2.1	2.2	1.5


Monitoring points	④																							
monitoring car	12:00	12:10	12:20	12:30	12:40	12:50	13:00	13:10	13:20	13:30	13:40	13:50	14:00	14:10	14:20	14:30	14:40	14:50	15:00	15:10	15:20	15:30	15:40	15:50
Reading (μ Sv/h)	225.2	226.0	224.8	224.9	224.7	224.8	225.4	224.8	225.7	224.1	223.7	222.7	222.4	231.1	435.0	288.7	309.7	267.8	265.4	396.0	415.6	414.7	401.6	318.4
neutron	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	NNW	NNE	W	W	WNW	E	E	ESE	N	N	NE	NW	N	NE	ESE	E	ESE	ESE	NE	N	E	SSE	ESE	ESE
wind speed (m/s)	1.6	2.6	1.6	1.6	1.5	1.4	1.2	1.9	2.0	1.5	1.3	1.2	1.4	1.0	1.6	0.9	1.6	1.7	1.6	1.5	1.3	1.0	1.1	0.7

Monitoring points	④																							
monitoring car	16:00	16:10	16:20	16:30	16:40	16:50	17:00	17:10	17:20	17:30	17:40	17:50	18:00	18:10	18:20	18:30	18:40	18:50	19:00	19:10	19:20	19:30	19:40	19:50
Reading (μ Sv/h)	331.5	313.4	280.9	283.7	274.4	269.3	265.1	262.1	259.5	257.0	255.8	254.2	253.0	251.3	241.2	249.0	246.9	245.8	244.6	243.5	242.1	241.0	240.2	237.6
neutron	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	E	S	SE	SSW	SSE	SW	N	E	NNW	NW	W	WNW	NW	NNW	N	NW	NNW	NE	N	N	N	NNE	W	WSW
wind speed (m/s)	0.9	0.9	1.3	1.0	0.8	0.9	0.5	0.6	2.1	2.2	2.7	2.0	1.5	0.9	2.3	2.1	2.3	1.7	1.2	1.4	0.8	0.4	0.4	0.8

Monitoring points	④																							
monitoring car	20:00	20:10	20:20	20:30	20:40	20:50	21:00	21:10	21:20	21:30	21:40	21:50	22:00	22:10	22:20	22:30	22:40	22:50	23:00	23:10	23:20	23:30	23:40	23:50
Reading (μ Sv/h)	236.5	235.8	235.3	234.3	233.2	232.8	232.3	231.5	230.6	230.2	229.5	228.8	228.3	227.3	226.8	226.5	225.8	225.4	224.9	224.7	224.3	224.0	223.0	223.0
neutron	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	NNE	E	SW	SW	E	E	WSW	SE	SSE	SW	W	WSW	W	W	W	W	WNW	WNW	W	NW	W	W	SW	SE
wind speed (m/s)	0.2	0.2	0.3	0.3	0.5	0.3	0.3	0.5	0.3	0.4	0.4	0.4	0.5	0.4	0.3	0.4	0.4	0.5	0.5	0.5	0.5	0.6	0.5	0.4

Dose rate measured in Fukushima Dai-ichi NPS

$\mu\text{Sv/h}$

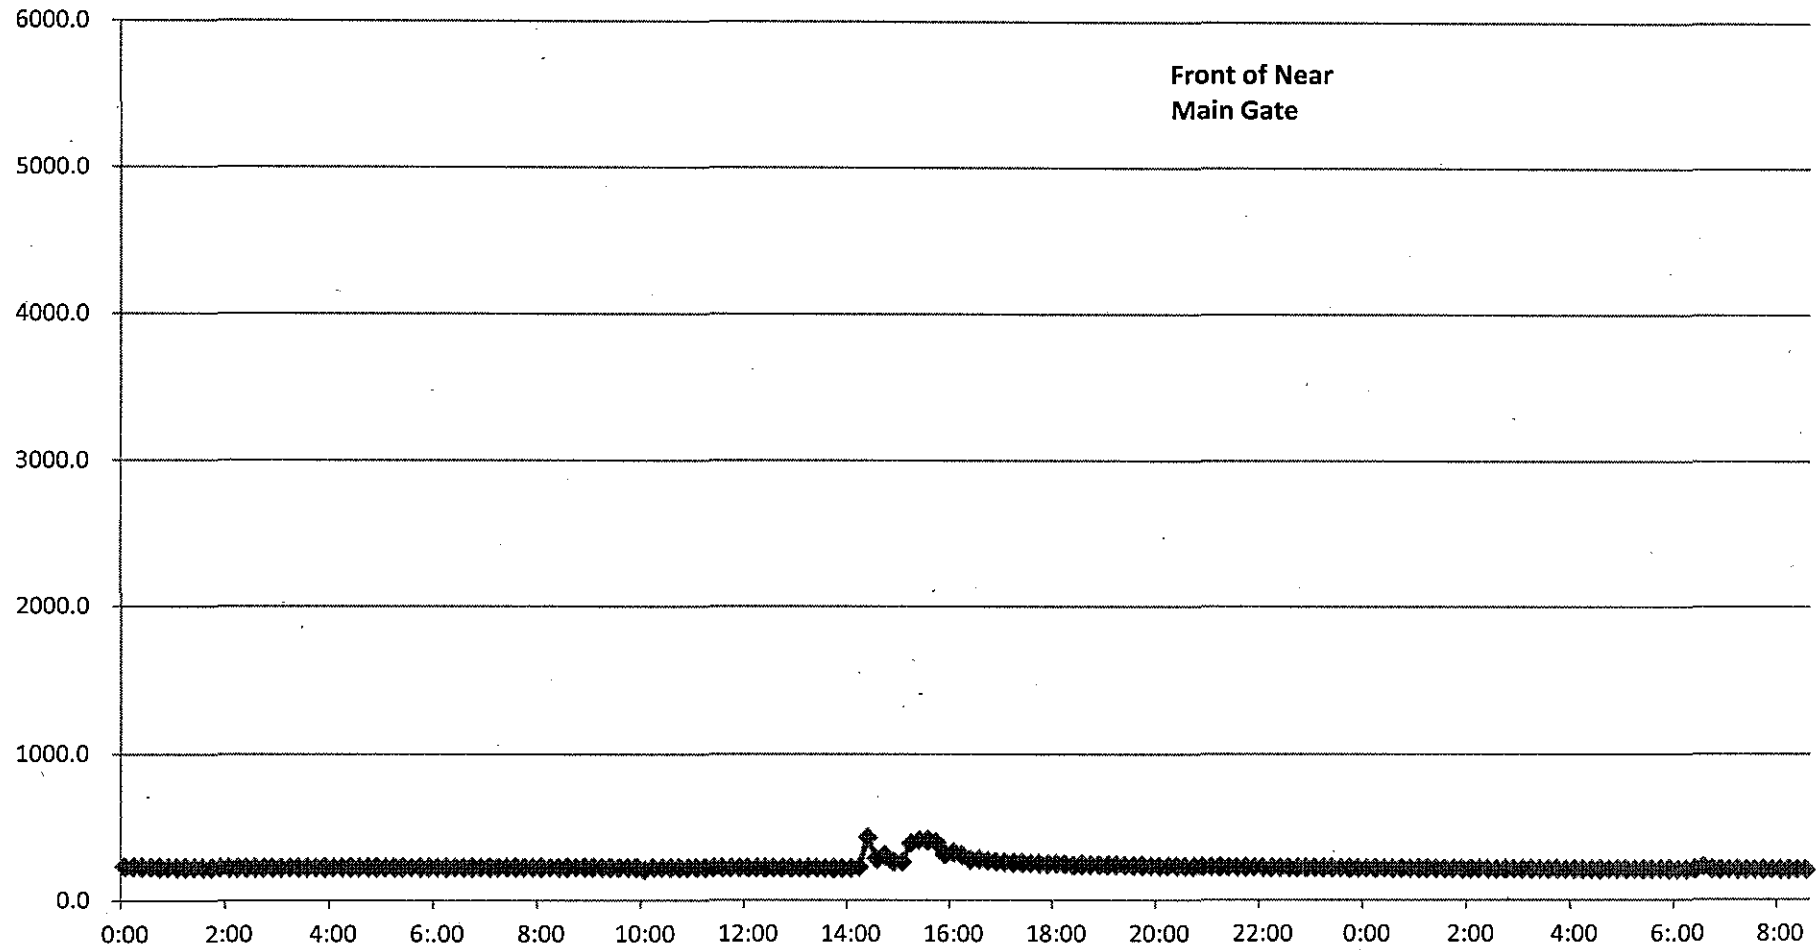


Front of Near
Main Gate

March 23rd

March 24th

Fukushima Dai-ichi NPS

as of 8:30, March 24th, 2011

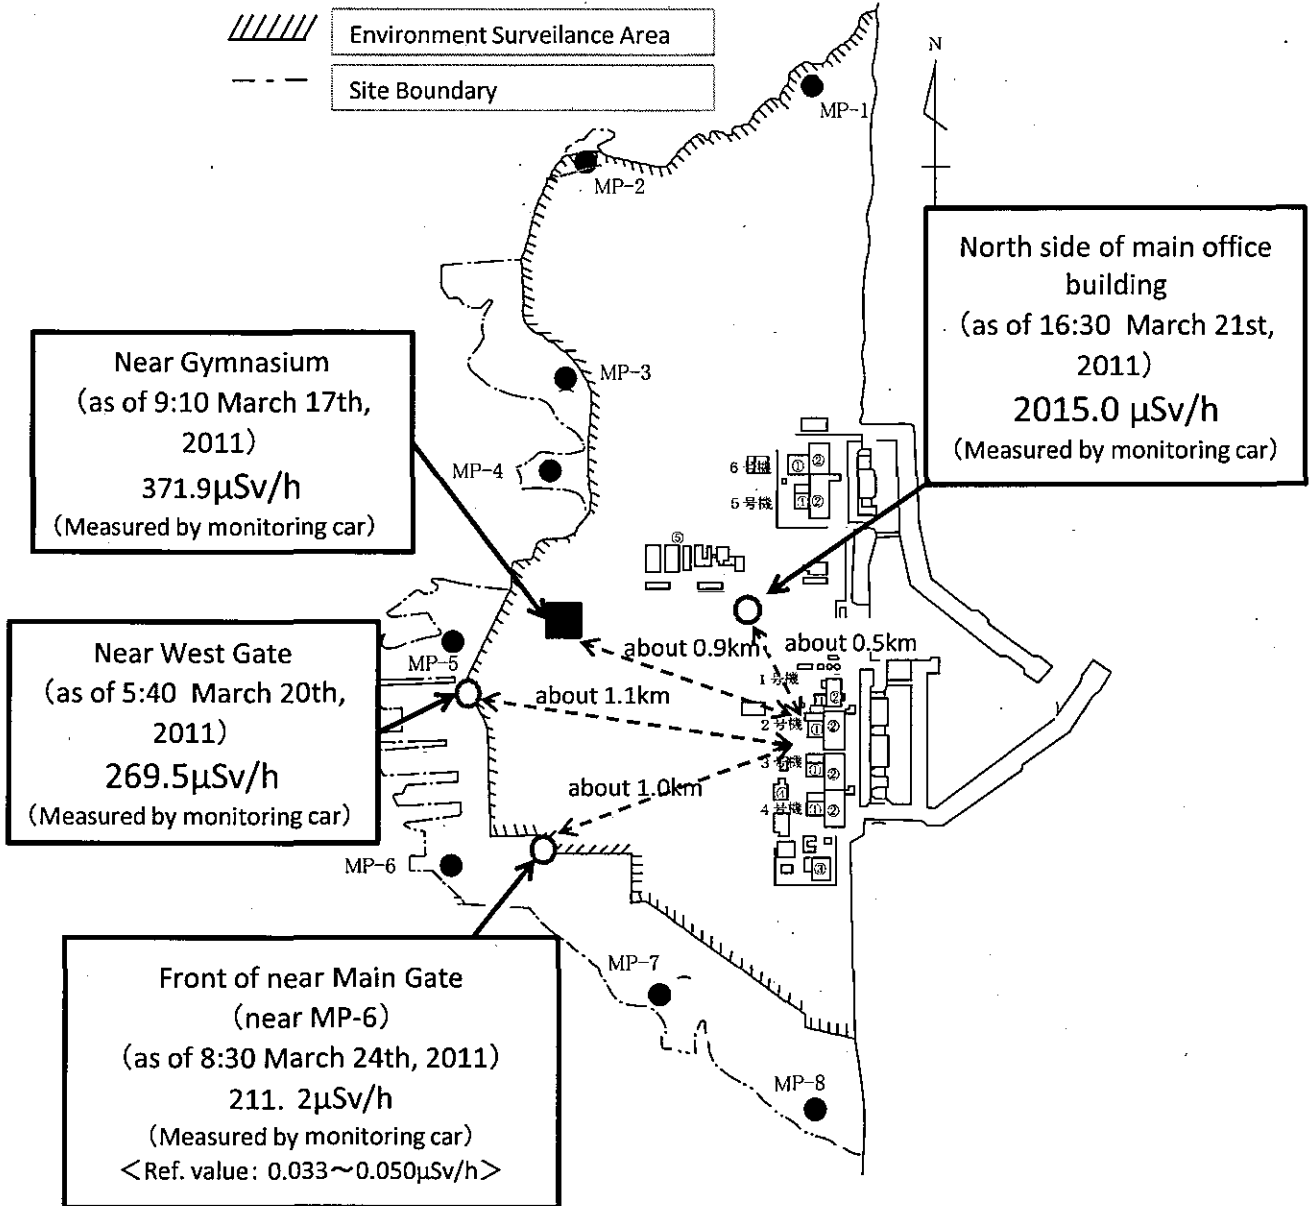

Fukushima Dai-ri (TEPCO's Monitoring Post)

W: West E: East S: South N: North

March 23rd, 2011																								
monitoring point	12:00	12:10	12:20	12:30	12:40	12:50	13:00	13:10	13:20	13:30	13:40	13:50	14:00	14:10	14:20	14:30	14:40	14:50	15:00	15:10	15:20	15:30	15:40	15:50
MP1 (μSv/h)	15.023	14.927	14.853	14.873	15.750	20.500	17.983	20.920	17.483	17.703	17.797	17.530	17.373	17.117	16.940	16.823	16.710	16.590	16.517	16.447	16.133	16.013	15.907	15.813
MP2 (μSv/h)	8.987	8.927	8.900	8.990	9.303	11.683	10.363	12.877	9.973	10.347	10.447	10.313	10.077	9.867	9.800	9.720	9.697	9.613	9.570	9.910	9.357	9.317	9.240	9.207
MP3 (μSv/h)	15.070	15.007	14.930	14.987	15.350	17.373	16.193	17.070	16.417	16.213	16.297	16.117	16.047	15.883	16.010	15.663	15.630	15.617	15.513	15.763	15.167	15.083	15.050	14.963
MP4 (μSv/h)	11.590	11.550	11.513	11.633	11.950	12.763	12.863	13.457	12.787	12.677	12.847	12.803	12.650	12.523	12.497	12.357	12.320	12.307	12.320	12.373	12.050	11.957	11.860	11.807
MP5 (μSv/h)	10.973	10.973	10.880	10.913	11.140	12.053	12.287	12.300	12.127	11.853	12.147	12.093	12.000	11.853	11.760	11.660	11.660	11.660	11.660	11.660	11.393	11.213	11.167	11.073
MP6 (μSv/h)	11.943	11.873	11.870	11.867	12.090	12.903	14.307	14.193	13.990	13.533	13.860	13.837	13.637	13.510	13.370	13.247	13.173	13.187	13.083	12.963	12.843	12.727	12.613	12.570
MP7 (μSv/h)	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	N	N	N	NNW	N	NE	NNE	NNE	NNE	NNE	NE	NE	NE	NNE	NNE	NE	ENE	ENE	ENE	NE	NE	NE	NNE	NNE
wind speed (m/s)	6.0	6.2	4.7	3.1	2.5	2.5	4.7	4.4	3.8	5.7	8.6	7.6	7.2	6.6	5.9	3.6	3.2	3.5	2.9	4.0	5.0	4.1	4.4	3.7

March 23rd, 2011																								
monitoring point	16:00	16:10	16:20	16:30	16:40	16:50	17:00	17:10	17:20	17:30	17:40	17:50	18:00	18:10	18:20	18:30	18:40	18:50	19:00	19:10	19:20	19:30	19:40	19:50
MP1 (μSv/h)	15.727	15.600	15.443	15.383	15.313	15.277	15.267	15.210	15.163	15.110	15.030	14.883	14.830	14.773	14.653	14.730	14.613	14.563	14.547	14.513	14.443	14.437	14.403	14.337
MP2 (μSv/h)	9.160	9.070	9.090	9.047	9.020	9.000	9.067	8.977	8.983	8.903	8.833	8.767	8.723	8.677	8.657	8.680	8.620	8.610	8.530	8.567	8.540	8.510	8.493	8.460
MP3 (μSv/h)	14.920	14.833	14.773	14.657	14.733	14.707	14.760	14.770	14.557	14.497	14.397	14.343	14.257	14.260	14.173	14.157	14.103	14.087	13.990	14.007	13.940	13.933	13.860	13.867
MP4 (μSv/h)	11.720	11.720	11.647	11.617	11.577	11.620	11.657	11.583	11.490	11.447	11.343	11.333	11.273	11.190	11.167	11.143	11.127	11.063	11.037	11.007	11.010	10.970	10.963	10.900
MP5 (μSv/h)	11.047	11.067	10.973	10.920	10.880	10.873	10.900	10.873	10.860	10.827	10.707	10.587	10.587	10.527	10.487	10.433	10.420	10.380	10.387	10.387	10.367	10.293	10.287	10.233
MP6 (μSv/h)	12.490	12.453	12.370	12.343	12.303	12.283	12.170	12.127	12.030	12.007	12.017	11.940	11.857	11.800	11.763	11.757	11.737	11.673	11.660	11.597	11.567	11.503	11.510	11.517
MP7 (μSv/h)	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	NE	NE	NNE	NE	NE	NNE	NNE	N	N	NNE	NNW	N	NNW	NNW	NNW	NNW	NNW	NNW	NNW	NNW	NNW	NW	NNW	NW
wind speed (m/s)	2.1	2.5	4.1	2.0	1.6	0.7	0.9	0.4	0.5	2.3	2.6	5.5	6.9	6.1	5.8	6.1	5.2	5.2	4.2	5.8	6.0	4.2	3.6	3.8

March 23rd, 2011																								
monitoring point	20:00	20:10	20:20	20:30	20:40	20:50	21:00	21:10	21:20	21:30	21:40	21:50	22:00	22:10	22:20	22:30	22:40	22:50	23:00	23:10	23:20	23:30	23:40	23:50
MP1 (μSv/h)	14.277	14.263	14.220	14.240	14.183	14.130	14.113	14.093	14.047	14.037	13.967	13.963	13.967	13.987	13.920	13.903	13.873	13.860	13.800	13.810	13.773	13.773	13.783	13.737
MP2 (μSv/h)	8.437	8.423	8.367	8.380	8.357	8.380	8.357	8.323	8.310	8.300	8.293	8.287	8.233	8.253	8.237	8.220	8.203	8.220	8.207	8.140	8.170	8.120	8.157	8.133
MP3 (μSv/h)	13.867	13.793	13.740	13.763	13.763	13.707	13.700	13.693	13.587	13.623	13.587	13.553	13.583	13.490	13.603	13.473	13.470	13.473	13.440	13.410	13.380	13.397	13.367	13.353
MP4 (μSv/h)	10.897	10.883	10.843	10.830	10.797	10.820	10.763	10.733	10.737	10.703	10.707	10.667	10.700	10.640	10.633	10.610	10.577	10.570	10.543	10.557	10.533	10.523	10.480	10.507
MP5 (μSv/h)	10.213	10.187	10.187	10.187	10.160	10.093	10.093	10.093	10.040	10.040	10.000	10.000	9.993	10.000	9.993	9.993	9.973	9.893	9.920	9.900	9.893	9.900	9.840	9.847
MP6 (μSv/h)	11.447	11.443	11.420	11.407	11.363	11.330	11.280	11.280	11.293	11.230	11.217	11.233	11.197	11.180	11.170	11.170	11.147	11.123	11.107	11.077	11.053	11.040	11.007	11.007
MP7 (μSv/h)	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	NW	NW	NW	NW	NW	NW	NW	NW	NW	NNW	NNW	NNW	NNW	NW	NW	NNW	NW	NNW	NW	WNW	NW	NW	NW	NW
wind speed (m/s)	5.0	6.6	8.5	8.3	7.5	6.1	6.7	6.9	5.5	4.0	3.3	4.7	6.5	7.2	6.1	6.4	6.6	6.5	6.7	7.1	4.7	7.0	6.4	6.1

W: West E: East S: South N: North


March 23rd, 2011																								
monitoring point	0:00	0:10	0:20	0:30	0:40	0:50	1:00	1:10	1:20	1:30	1:40	1:50	2:00	2:10	2:20	2:30	2:40	2:50	3:00	3:10	3:20	3:30	3:40	3:50
MP1 (μ Sv/h)	16.337	16.260	16.067	16.060	15.887	15.700	15.660	15.570	15.537	15.470	15.393	15.410	15.290	15.243	15.180	15.190	15.103	15.083	15.000	14.953	14.953	14.953	14.907	14.873
MP2 (μ Sv/h)	9.703	9.627	9.560	9.447	9.333	9.233	9.193	9.177	9.113	9.080	9.043	8.973	8.960	8.960	8.960	8.907	8.897	8.877	8.867	8.837	8.837	8.837	8.797	8.803
MP3 (μ Sv/h)	15.347	15.200	15.130	15.047	14.967	14.833	14.790	14.803	14.737	14.650	14.603	14.570	14.540	14.500	14.490	14.517	14.477	14.433	14.383	14.350	14.350	14.350	14.310	14.360
MP4 (μ Sv/h)	12.243	12.123	12.060	11.937	11.847	11.797	11.750	11.723	11.667	11.650	11.557	11.547	11.527	11.453	11.487	11.460	11.417	11.413	11.403	11.367	11.367	11.367	11.307	11.340
MP5 (μ Sv/h)	11.467	11.367	11.267	11.167	11.040	10.973	10.880	10.873	10.873	10.780	10.760	10.680	10.680	10.680	10.680	10.680	10.673	10.627	10.593	10.580	10.580	10.580	10.580	10.587
MP6 (μ Sv/h)	12.620	12.503	12.407	12.297	12.187	12.103	12.053	12.007	11.930	11.900	11.810	11.820	11.793	11.823	11.770	11.763	11.713	11.743	11.703	11.697	11.697	11.697	11.687	11.667
MP7 (μ Sv/h)	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	NNW	NW	NNW	NW	NW	NNW	NNW	N	N	N	N	N	N	N	N	NNW	N	N	N	N	N	N	N	NNW
wind speed (m/s)	2.7	3.9	5.0	4.8	4.4	4.3	4.5	5.7	6.6	8.2	8.2	7.4	9.1	8.6	9.9	8.4	9.7	9.0	9.9	7.7	7.7	7.7	8.6	8.3

March 23rd, 2011																								
monitoring point	4:00	4:10	4:20	4:30	4:40	4:50	5:00	5:10	5:20	5:30	5:40	5:50	6:00	6:10	6:20	6:30	6:40	6:50	7:00	7:10	7:20	7:30	7:40	7:50
MP1 (μ Sv/h)	14.860	14.797	14.773	14.723	14.740	14.713	14.630	14.670	14.593	14.577	14.553	14.423	14.520	14.507	14.460	14.450	14.467	14.400	14.403	14.380	14.347	14.390	14.343	14.337
MP2 (μ Sv/h)	8.813	8.787	8.790	8.803	8.773	8.737	8.740	8.713	8.723	8.700	8.683	8.680	8.640	8.657	8.653	8.643	8.620	8.603	8.593	8.570	8.603	8.570	8.570	8.563
MP3 (μ Sv/h)	14.293	14.317	14.250	14.260	14.260	14.213	14.227	14.223	14.170	14.117	14.173	14.167	14.123	14.133	14.093	14.080	14.060	14.027	14.057	14.053	13.987	14.007	14.017	13.983
MP4 (μ Sv/h)	11.313	11.313	11.273	11.253	11.260	11.263	11.237	11.220	11.193	11.193	11.197	11.153	11.173	11.170	11.133	11.153	11.127	11.130	11.113	11.080	11.097	11.117	11.050	11.053
MP5 (μ Sv/h)	10.587	10.587	10.587	10.587	10.480	10.520	10.480	10.480	10.480	10.480	10.487	10.480	10.433	10.480	10.480	10.427	10.387	10.407	10.380	10.387	10.387	10.387	10.380	10.387
MP6 (μ Sv/h)	11.630	11.643	11.620	11.600	11.623	11.597	11.580	11.550	11.607	11.580	11.533	11.577	11.567	11.510	11.487	11.497	11.480	11.487	11.480	11.480	11.450	11.423	11.417	11.467
MP7 (μ Sv/h)	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
wind speed (m/s)	8.6	8.5	8.0	7.8	8.3	7.7	7.5	7.1	7.6	7.5	8.7	8.6	8.2	8.7	9.1	8.5	9.9	8.9	9.6	8.6	8.6	8.0	9.4	8.9

March 23rd, 2011																								
monitoring point	8:00	8:10	8:20	8:30	8:40	8:50	9:00	9:10	9:20	9:30	9:40	9:50	10:00	10:10	10:20	10:30	10:40	10:50	11:00	11:10	11:20	11:30	11:40	11:50
MP1 (μ Sv/h)	14.307	15.697	16.200	19.693	17.380	17.463	16.780	16.483	16.347	16.143	16.010	15.917	15.783	15.657	15.590	15.533	15.453	15.407	15.323	15.187	15.380	15.260	15.133	15.073
MP2 (μ Sv/h)	8.573	8.923	9.273	11.147	10.563	10.817	9.570	9.350	9.277	9.197	9.190	9.097	9.057	9.067	9.067	9.027	8.983	8.943	8.903	8.917	9.307	9.120	9.077	8.967
MP3 (μ Sv/h)	13.953	13.980	14.407	15.590	17.423	18.627	17.130	16.520	16.220	16.110	15.933	15.813	15.693	15.613	15.510	15.453	15.397	15.447	15.227	15.357	15.853	15.540	15.277	15.163
MP4 (μ Sv/h)	11.060	11.077	11.377	13.130	13.253	13.147	12.330	12.273	12.070	12.013	11.920	11.873	11.780	11.750	11.770	11.667	11.737	11.787	11.657	11.693	11.933	12.607	11.713	11.700
MP5 (μ Sv/h)	10.380	10.380	10.613	13.813	12.420	12.147	11.567	11.620	11.367	11.367	11.213	11.167	11.153	11.113	11.073	11.073	11.053	11.173	10.920	11.220	11.287	11.713	11.153	11.067
MP6 (μ Sv/h)	11.443	11.463	12.017	14.217	13.800	12.843	12.550	12.540	12.447	12.383	12.273	12.233	12.183	12.117	12.127	12.083	12.073	11.997	11.940	11.970	12.023	12.107	11.987	11.973
MP7 (μ Sv/h)	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D	N.D
wind direction	N	N	N	N	N	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	NNE	N	NNE	NNE
wind speed (m/s)	7.7	8.1	7.9	7.4	7.2	7.7	9.0	8.9	10.2	10.3	8.2	8.2	9.2	10.1	7.5	7.0	7.7	8.0	7.4	7.1	8.6	6.0	5.4	6.5

Fukushima Dai-ri NPS

as of 8:30, March 24th, 2011

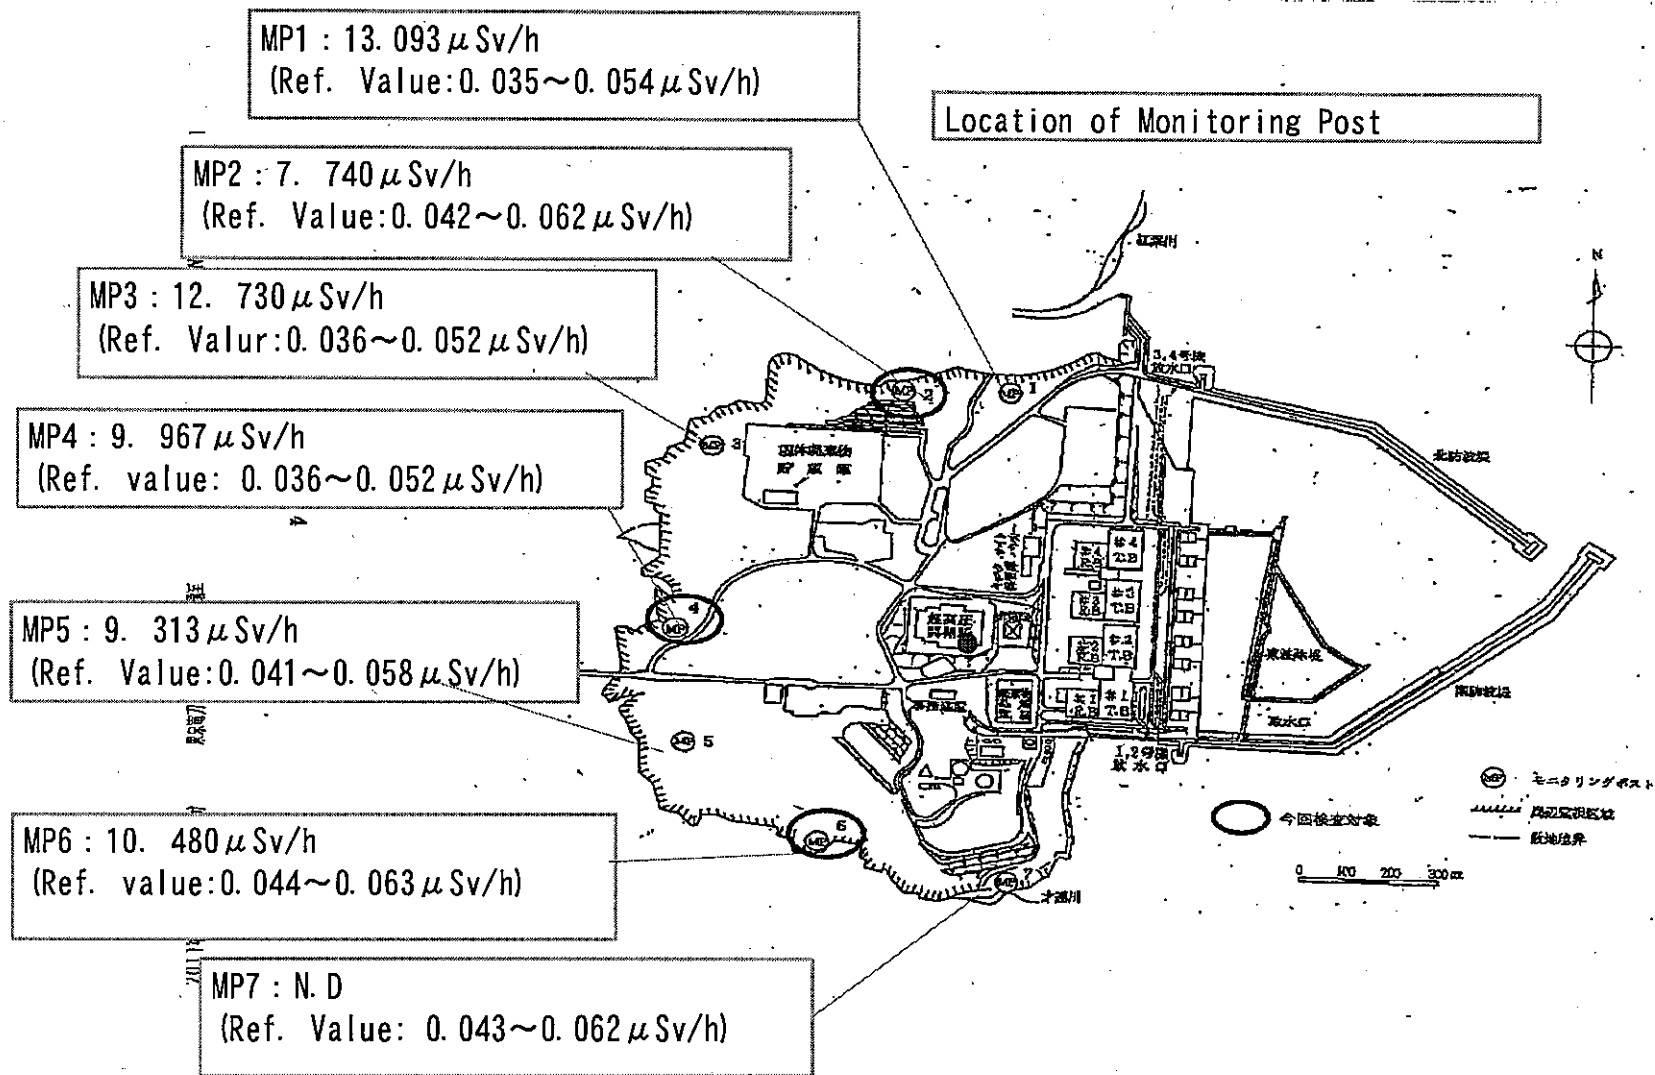

添付資料 (2)

Results of environmental monitoring at each NPSs etc.

unit: μ Sv/h

Range of normal average value	Company	NPS	March 23rd, 2011											
			0:00	1:00	2:00	3:00	4:00	5:00	6:00	7:00	8:00	9:00	10:00	11:00
0.023~0.027	Hokkaido Electric Power Co.	Tomari NPS	0.029	0.027	0.025	0.026	0.025	0.034	0.029	0.027	0.027	0.029	0.026	0.030
0.024~0.060	Tohoku Electric Power Co.	Onagawa NPS	1.300	1.300	1.300	1.300	1.300	1.200	1.200	1.200	1.200	1.200	1.200	1.200
0.012~0.060		Higashidori NPS	0.017	0.017	0.018	0.018	0.018	0.018	0.018	0.019	0.019	0.019	0.018	0.019
0.033~0.050	Tokyo Electric Power Co.	Fukushima Dai-ichi*	233.4	227.5	226.7	227.6	229.1	229.5	229.6	229.3	229.4	229.1	211.4	227.0
0.036~0.052		Fukushima Dai-ni	15.347	14.790	14.540	14.383	14.293	14.227	14.123	14.057	13.953	17.130	15.693	15.227
0.011~0.159		Kashiwazaki kariwa NPS	0.077	0.077	0.077	0.083	0.073	0.067	0.067	0.065	0.064	0.066	0.063	0.063
0.036~0.053	Japan Atomic Power Co.	Tokai Dai-ni NPS	1.093	1.081	1.072	1.063	1.058	1.050	1.047	1.047	1.044	1.039	1.043	1.095
0.039~0.110		Tsuruga NPS	0.073	0.073	0.075	0.074	0.073	0.073	0.075	0.072	0.073	0.073	0.075	0.074
0.064~0.108	Chubu Electric Power Co.	Hamaoka NPS	0.087	0.087	0.087	0.087	0.087	0.087	0.087	0.086	0.086	0.086	0.085	
0.0207~0.132	Hokuriku Electric Power Co.	Shika NPS	0.034	0.033	0.033	0.032	0.032	0.032	0.032	0.032	0.032	0.031	0.032	0.032
0.028~0.130	Chugoku Electric Power Co.	Shimane NPS	0.030	0.030	0.030	0.031	0.031	0.030	0.031	0.030	0.030	0.032	0.030	0.029
0.070~0.077	Kansai Electric Power Co.	Mihama NPS	0.073	0.072	0.072	0.072	0.073	0.072	0.072	0.072	0.072	0.073	0.074	0.072
0.045~0.047		Takahama NPS	0.043	0.043	0.042	0.042	0.042	0.042	0.042	0.042	0.043	0.043	0.043	0.043
0.036~0.040		Ooi NPS	0.036	0.035	0.034	0.035	0.034	0.034	0.034	0.035	0.033	0.035	0.000	0.000
0.011~0.080	Shikoku Electric Power Co.	Ikata NPS	0.014	0.015	0.014	0.014	0.014	0.014	0.014	0.014	0.015	0.015	0.014	0.015
0.023~0.087	Kyushu Electric Power Co.	Genkai NPS	0.027	0.027	0.025	0.026	0.027	0.026	0.026	0.026	0.026	0.027	0.026	0.026
0.034~0.120		Sendai NPS	0.038	0.035	0.038	0.036	0.038	0.037	0.037	0.036	0.037	0.037	0.040	0.037
0.009~0.069	Japan Nuclear Fuel Limited	Japan Nuclear Fuel Reprocessing Plant	0.016	0.016	0.016	0.017	0.016	0.016	0.016	0.017	0.017	0.017	0.018	0.017
0.009~0.071		Japan Nuclear Fuel Plant Disposal	0.020	0.019	0.019	0.020	0.020	0.020	0.019	0.020	0.022	0.021	0.021	0.020

*There could be small deviation on the monitoring time and area because of operational situation concerning with data of Fukushima Dai-ichi NPS

Range of normal average value	Company	NPS	March 23rd, 2011											
			12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00	21:00	22:00	23:00
0.023~0.027	Hokkaido Electric Power Co.	Tomari NPS	0.028	0.026	0.026	0.026	0.025	0.024	0.025	0.026	0.026	0.030		
0.024~0.060	Tohoku Electric Power Co.	Onagawa NPS	1.300	1.300	1.300	1.300	1.200	1.200	1.200	1.200	1.200	1.200		
0.012~0.060		Higashidori NPS	0.021	0.019	0.019	0.018	0.018	0.018	0.018	0.018	0.017	0.017		
0.033~0.050	Tokyo Electric Power Co.	Fukushima Dai-ichi*	225.2	225.4	222.4	265.4	331.5	265.1	263.0	244.6	236.5	232.3		
0.036~0.052		Fukushima Dai-ni	15.070	16.193	16.047	15.513	14.920	14.760	14.257	13.990	13.867	13.700		
0.011~0.159		Kashiwazaki kariwa NPS	0.064	0.065	0.064	0.065	0.065	0.065	0.066	0.064	0.064	0.064		
0.036~0.053	Japan Atomic Power Co.	Tokai Dai-ni NPS	1.149	1.113	1.123	1.109	1.085	1.076	1.055	1.037	1.034	1.031		
0.039~0.110		Tsuruga NPS	0.073	0.073	0.072	0.073	0.073	0.072	0.072	0.073	0.073	0.074		
0.064~0.108	Chubu Electric Power Co.	Hamaoka NPS	0.085	0.084	0.084	0.084	0.084	0.084	0.083	0.084	0.084	0.084		
0.0207~0.132	Hokuriku Electric Power Co.	Shika NPS	0.032	0.032	0.032	0.032	0.032	0.033	0.032	0.033	0.032	0.032		
0.028~0.130	Chugoku Electric Power Co.	Shimane NPS	0.030	0.030	0.030	0.031	0.031	0.029	0.029	0.029	0.030	0.030		
0.070~0.077	Kansai Electric Power Co.	Mihama NPS	0.073	0.072	0.071	0.071	0.074	0.071	0.072	0.073	0.073	0.072		
0.045~0.047		Takahama NPS	0.042	0.043	0.043	0.042	0.043	0.042	0.043	0.043	0.043	0.042	0.042	
0.036~0.040		Ooi NPS	0.000	0.000	0.000	0.000	0.000	0.000	0.034	0.035	0.033	0.034		
0.011~0.080	Shikoku Electric Power Co.	Ikata NPS	0.014	0.014	0.014	0.014	0.014	0.014	0.013	0.013	0.014	0.014		
0.023~0.087	Kyushu Electric Power Co.	Genkai NPS	0.026	0.026	0.026	0.026	0.026	0.025	0.026	0.026	0.026	0.026	0.026	
0.034~0.120		Sendai NPS	0.037	0.038	0.038	0.038	0.037	0.039	0.034	0.036	0.039	0.039	0.039	
0.009~0.069	Japan Nuclear Fuel Limited	Japan Nuclear Fuel Reprocessing Plant	0.018	0.017	0.017	0.016	0.016	0.016	0.016	0.016	0.016	0.016	0.016	
0.009~0.071		Japan Nuclear Fuel Plant Disposal	0.022	0.021	0.020	0.020	0.019	0.020	0.020	0.020	0.020	0.020	0.020	

*There could be small deviation on the monitoring time and area because of operational situation concerning with data of Fukushima Dai-ichi NPS

Results of Nuclide Analysis in TEPCO Fukushima Dai-ichi NPS

Sampling Method:Extraction of Dust by Monitoring Car

Measuring Method: Analysis of Samples by Ge-Semiconductor Nuclide Analyzer in Fukushima Dai-ichi NPS (once in a day)

Measuring time:500 seconds

Nuclide	March 19th, 2011			March 20th, 2011			March 21st, 2011			③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※	
	North of Main Building			North of Main Building			North of Main Building				
	Sampling Time(11:53~12:13) * Before Water Spraying			Sampling Time(1:41~2:01)			Sampling Time(10:19~10:39)				
	Measuring Duration(14:12~)			Measuring Duration(13:28~)			Measuring Duration(13:28~)				
	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Air ((1)/(3))	① Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Air ((1)/(3))	① Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air ((1)/(3))		
Volitile	I-131	5.940E-03	3.374E-05	5.94	2.303E-03	1.256E-05	2.30	1.516E-03	1.134E-05	1.52	1.0E-03
	I-132	2.203E-03	8.816E-05	0.03	N.D			2.539E-04	2.702E-05	0.00	7.0E-02
	I-133	3.773E-05	2.861E-05	0.01	N.D			N.D			5.0E-03
In Particle	Cs-134	2.165E-05	1.692E-05	0.01	2.840E-05	4.755E-06	0.01	3.383E-05	5.364E-06	0.02	2.0E-03
	Cs-136	N.D			5.629E-06	5.447E-06	0.0005629	4.529E-06	3.321E-06	0.0005	1.0E-02
	Cs-137	2.437E-05	1.771E-05	0.01	2.892E-05	5.003E-06	0.01	3.801E-05	4.671E-06	0.01	3.0E-03

Nuclide	March 22nd, 2011			March 23rd, 2011						③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※	
	Main Gate			Main Gate							
	Sampling Time(1:10~1:30)			Sampling Time(2:01~2:21)							
	Measuring Duration(14:50~)			Measuring Duration(14:54~)							
	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Air ((1)/(3))	① Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air ((1)/(3))	① Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air ((1)/(3))		
Volitile	I-131	2.239E-03	1.569E-05	2.24	6.7E-04	9.6E-06	0.67				1.0E-03
	I-132	N.D			3.0E-04	8.8E-06	0.00				7.0E-02
	I-133	N.D									5.0E-03
In Particle	Co-58	N.D			5.1E-06	5.1E-06	0.00				1.0E-02
	Cs-134	1.591E-05	5.853E-06	0.01	1.7E-05	4.2E-06	0.01				2.0E-03
	Cs-136	N.D			3.0E-06	2.7E-06	0.00				1.0E-02
	Cs-137	1.889E-05	5.295E-06	0.01	1.3E-05	4.2E-06	0.00				3.0E-03
Other	Te-129	N.D			2.3E-01	1.2E-01	0.58				4.0E-01
	Te-132	6.680E-05	1.116E-05	0.01	4.3E-04	4.5E-06	0.06				7.0E-03
	Ce-144	6.680E-05	1.116E-05	0.10	1.3E-03	3.7E-04	1.86				7.0E-04

※Legal concentration limit provided to average density of three months of radionuclide in air that person breathes.

Sampling Method: Sampling by Pumping Seawater

Measuring Method: Analysis of 500 ml Seawater Sample by Ge-Semiconductor Nuclide Analyzer in Fukushima Dai-ri NPS

Measuring time: 1000 seconds

Nuclide	as of 14:30, March 21st, 2011			as of 06:30, March 22nd, 2011			as of 08:50, March 23rd, 2011			③Conc. Limit in Water outside Environmental Monitoring Area
	Near south water discharge gate (Unit1-4 330m from water discharge gate in direction of			Near south water discharge gate (Unit1-4 330m from water discharge gate in direction of			Near south water discharge gate (Unit1-4 330m from water discharge gate in direction of			
	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water ((1)/(3))	① Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water ((1)/(3))	① Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water ((1)/(3))	
Co-58	5.955E-02	3.349E-02	0.1	1.668E-02	2.138E-02	0.0	5.0E-02	2.6E-02	-	1.0E+00
I-131	5.066E+00	4.245E-02	126.7	1.190E+00	2.293E-02	29.8	5.9E+00	3.6E-02	146.9	4.0E-02
I-132	2.136E+00	1.925E-01	0.7	1.362E+00	7.721E-02	0.5	5.4E+00	1.4E-01	1.8	3.0E+00
Cs-134	1.486E+00	4.030E-02	24.8	1.504E-01	1.769E-02	2.5	2.5E-01	2.7E-02	4.2	6.0E-02
Cs-136	2.132E-01	2.358E-02	0.7	2.350E-02	1.056E-02	0.1	2.5E-02	2.4E-02	0.1	3.0E-01
Cs-137	1.484E+00	4.204E-02	16.5	1.535E-01	1.626E-02	1.7	2.5E-01	2.7E-02	2.8	9.0E-02
Zr-95							2.3E-01	7.8E-02	0.3	9E-01
Ru-105							6.7E-01	6.2E-01	0.3	3E+00
Ru-106							3.7E-01	2.0E-01	3.7	1E-01
Te-129							4.0E+00	3.9E+00	0.4	1E+01
Te-132							4.0E+01	3.6E-02	200.5	2E-01
La-140							1.3E-02	1.0E-02	0.0	4E-01

Results of Nuclide Analysis in TEPCO Fukushima Dai-ri NPS

Sampling Method: Extraction of Dust by Monitoring Car

Measuring Method: Analysis of Samples by Ge-Semiconductor Nuclide Analyzer in Fukushima Dai-ri NPS (twice in a day)

Nuclide		March 16th, 2011			March 16th, 2011			March 17th, 2011			③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※
		East Side of Information Building			1st Floor Entrance of Earthquake Isolation Building			MP-1			
		Sampling Time (7:56~8:06)			Sampling Time (10:00~10:10)			Sampling Time (13:50~14:00)			
		Measuring Duration(8:47~) 500 seconds			Measuring Duration(11:59~) 500 seconds			Measuring Duration(22:01~) 1000 seconds			
		①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	
Volatile	I-131	3.432E-04	2.559E-05	0.34	6.889E-04	1.268E-05	0.69	9.432E-05	3.351E-06	0.09	1.0E-03
	I-132	1.149E-03	2.812E-05	0.02	7.528E-04	1.986E-05	0.01	N.D			7.0E-02
	I-133	3.448E-05	2.687E-05	0.01	4.395E-05	1.497E-05	0.01	3.304E-06	4.478E-06	0.00	5.0E-03
In Particle	Co-58	N.D			4.943E-05	2.685E-05	0.00	2.494E-05	2.061E-05	0.00	1.0E-02
	Cs-134	1.237E-04	1.449E-05	0.06	4.163E-04	2.459E-05	0.21	3.314E-04	1.680E-05	0.17	2.0E-03
	Cs-136	2.699E-05	9.412E-06	0.00	7.504E-05	1.495E-05	0.01	6.107E-05	1.296E-05	0.01	1.0E-02
	Cs-137	1.227E-04	1.311E-05	0.04	3.861E-04	2.057E-05	0.13	3.232E-04	1.702E-05	0.11	3.0E-03

Nuclide		March 18th, 2011			March 18th, 2011			March 19th, 2011			③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※
		MP-1			MP-1			MP-1			
		Sampling Time (8:22~8:32)			Sampling Time (15:09~15:19)			Sampling Time (9:15~9:25)			
		Measuring Duration(9:40~) 1000 seconds			Measuring Duration(17:12~) 1000 seconds			Measuring Duration(10:39~) 1000 seconds			
		①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	
Volatile	I-131	8.630E-04	3.145E-05	0.86	4.298E-03	4.993E-05	4.30	2.695E-04	5.585E-05	0.27	1.0E-03
	I-132	1.720E-03	3.821E-05	0.02	2.625E-03	9.359E-05	0.04	N.D			7.0E-02
	I-133	N.D			5.246E-05	4.213E-05	0.01	N.D			5.0E-03
In Particle	Co-58	3.080E-05	2.048E-05	0.00	1.578E-04	1.435E-05	0.02	N.D			1.0E-02
	Cs-134	3.345E-04	1.666E-05	0.17	4.863E-04	1.538E-05	0.24	N.D			2.0E-03
	Cs-136	5.882E-05	1.012E-05	0.01	8.416E-05	1.436E-05	0.01	N.D			1.0E-02
	Cs-137	3.147E-04	1.683E-05	0.10	4.306E-04	1.715E-05	0.14	N.D			3.0E-03

※Legal concentration limit provided to average density of three months of radionuclide in air that person breathes.

Nuclide		March 19th, 2011			March 20th, 2011			March 20th, 2011			③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※
		MP-1			MP-1			MP-1			
		Sampling Time (18:18~18:28)			Sampling Time (11:27~11:37)			Sampling Time (17:10~17:20)			
		Measuring Duration(19:08~)			Measuring Duration(16:17~)			Measuring Duration(21:11~)			
		1000 seconds			500 seconds			500 seconds			
		①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	
Volatile	I-131	2.513E-04	5.665E-05	0.25	5.254E-05	1.155E-05	0.05	2.230E-04	4.286E-05	0.22	1.0E-03
	I-132	1.229E-04	1.226E-04	0.00	N.D			N.D			7.0E-02
	I-133	N.D			N.D			N.D			5.0E-03
In Particle	Co-58	N.D			N.D			N.D			1.0E-02
	Cs-134	N.D			N.D			N.D			2.0E-03
	Cs-136	N.D			N.D			N.D			1.0E-02
	Cs-137	N.D			N.D			N.D			3.0E-03

Nuclide		March 21st, 2011			March 21st, 2011			March 23rd, 2011			③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※
		MP-1			MP-1			MP-1			
		Sampling Time(10:40~10:50)			Sampling Time(18:11~18:19)			Sampling Time(16:06~16:14)			
		Measuring Duration(12:15~)			Measuring Duration(19:00~)			Measuring Duration(17:38~)			
		500 seconds			500 seconds			500 seconds			
		①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Air (①/③)	
Volatile	I-131	2.250E-04	1.687E-05	0.23	1.580E-04	1.931E-05	0.16	2.1E-04	1.4E-05	0.21	1.0E-03
	I-132	2.420E-04	2.401E-05	0.00	8.097E-04	1.937E-05	0.01	2.8E-04	2.8E-05	0.00	7.0E-02
	I-133	N.D						N.D			5.0E-03
In Particle	Co-58	1.065E-05	1.138E-05	0.00	1.341E-05	9.886E-06	0.00	N.D			1.0E-02
	Cs-134	4.410E-05	9.294E-06	0.02	3.017E-05	1.005E-05	0.02	1.7E-05	8.5E-06	0.01	2.0E-03
	Cs-136	N.D			N.D			3.7E-06	5.2E-06	0.00	1.0E-02
	Cs-137	4.711E-05	7.959E-06	0.02	3.306E-05	9.703E-06	0.01	1.7E-05	6.9E-06	0.01	3.0E-03
Others	Te-129							9.3E-04	2.6E-04	0.93	1.0E-03
	Te-132							7.1E-04	6.5E-06	0.10	7.0E-03
	Ru-106							8.2E-05	5.7E-05	0.14	6.0E-04

※Legal concentration limit provided to average density of three months of radionuclide in air that person breathes.

Nuclide		March 22nd, 2011 MP-1			March 22nd, 2011 MP-1			March 23rd, 2011 MP-1			③Conc. Limit in Air Breathed by Radiation Worker (Bq/cm ³)※
		Sampling Time(10:40~10:50)			Sampling Time (16:43~16:51)			Sampling Time (16:06~16:14)			
		Measuring Duration(12:15~) 500 seconds			Measuring Duration(17:32~) 500 seconds			Measuring Duration(17:38~) 500 seconds			
		①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Air (①/③)	
		Volitile	I-131	1.416E-04	2.272E-05	0.14	1.349E-04	2.216E-05	0.13	2.1E-04	
	I-132	N.D			N.D			2.8E-04	2.8E-05	0.00	7.0E-02
	I-133	N.D			N.D			N.D			5.0E-03
In Particle	Co-58	N.D			N.D			N.D			1.0E-02
	Cs-134	1.293E-05	9.474E-06	0.01	1.353E-05	9.812E-06	0.01	1.7E-05	8.5E-06	0.01	2.0E-03
	Cs-136	N.D			N.D			3.7E-06	5.2E-06	0.00	1.0E-02
	Cs-137	1.024E-05	8.838E-06	0.003	1.369E-05	8.361E-06	0.005	1.7E-05	6.9E-06	0.01	3.0E-03
others	Te-129	2.316E-03	1.784E-03	0.01	N.D			9.3E-04	2.6E-04	0.00	4.0E-01
	Te-132	2.191E-05	1.649E-05	0.003	N.D			7.1E-04	6.5E-06	0.01	7.0E-02
	Ru-106	N.D			N.D			8.2E-05	5.7E-05	0.14	6.0E-04

※Legal concentration limit provided to average density of three months of radionuclide in air that person breathes.

Sampling Method: Sampling by Pumping Seawater

Measuring Method: Analysis of 500 ml Seawater Sample by Ge-Semiconductor Nuclide Analyzer

Measuring time: 1,000 seconds

Nuclide	as of 23:15, March 21st, 2011			as of 23:45, March 21st, 2011			as of 0:38, March 22nd, 2011			③Conc. Limit in Water outside Environmental Monitoring Area
	Near north water discharge gate (water discharge gate of			Near Iwasawa Seashore (around 7,000m from water			Near mouth of Tomioka River (around 2,000m from water			
	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Water (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water (①/③)	
Co-58	5.704E-03	7.570E-03	0.0	N.D	6.845E-03		1.028E-02	1.253E-02	0.0	1.0E+00
I-131	1.085E+00	1.284E-02	27.1	6.558E-01	1.226E-02	16.4	3.211E+00	1.694E-02	80.3	4.0E-02
I-132	1.597E-01	4.392E-02	0.1	1.205E-01	4.146E-02	0.0	8.761E-01	4.236E-02	0.3	3.0E+00
Cs-134	4.815E-02	9.213E-03	0.8	3.110E-02	8.657E-03	0.5	7.535E-02	1.102E-02	1.3	6.0E-02
Cs-136	6.682E-03	4.722E-03	0.0	5.474E-03	4.840E-03	0.0	1.159E-02	7.718E-02	0.0	3.0E-01
Cs-137	5.283E-02	8.822E-03	0.6	3.292E-02	8.303E-03	0.4	7.760E-02	1.186E-02	0.9	9.0E-02

Nuclide	as of 14:28, March 22nd, 2011			as of 13:51, March 23rd, 2011			as of 14:25, March 23rd, 2011			③Conc. Limit in Water outside Environmental Monitoring Area
	Near north water discharge gate (water discharge gate of			Near Iwasawa Seashore (around 7,000m from water			Near Iwasawa Seashore (around 7,000m from water			
	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit In Water (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water (①/③)	①Conc. of Radioactivity (Bq/cm ³)	②Conc. of Detection Limit (Bq/cm ³)	Ratio of Conc.Limit in Water (①/③)	
Co-58	N.D	1.526E-02								1.0E+00
Ru-105				3.4E-02	2.5E-02		3.3E-02	2.8E-02	0.01	3E+00
Ru-106							1.2E-01	1.2E-01	1.25	1E-01
I-131	1.138E+00	1.993E-02	28.5	7.4E-01	2.7E-02	16.7	7.6E-01	2.7E-02	19.1	4.0E-02
I-132	N.D	8.791E-02		2.0E-01	5.8E-02		3.3E-01	5.3E-02	0.1	3.0E+00
Cs-134	4.631E-02	1.350E-02	0.8	5.1E-02	2.0E-02	0.7	3.3E-02	2.1E-02	0.5	6.0E-02
Cs-136	N.D	7.849E-03								3.0E-01
Cs-137	3.962E-02	1.406E-02	0.4	5.5E-02	2.0E-02	0.5	4.3E-02	2.1E-02	0.5	9.0E-02